


PLAN VIEW

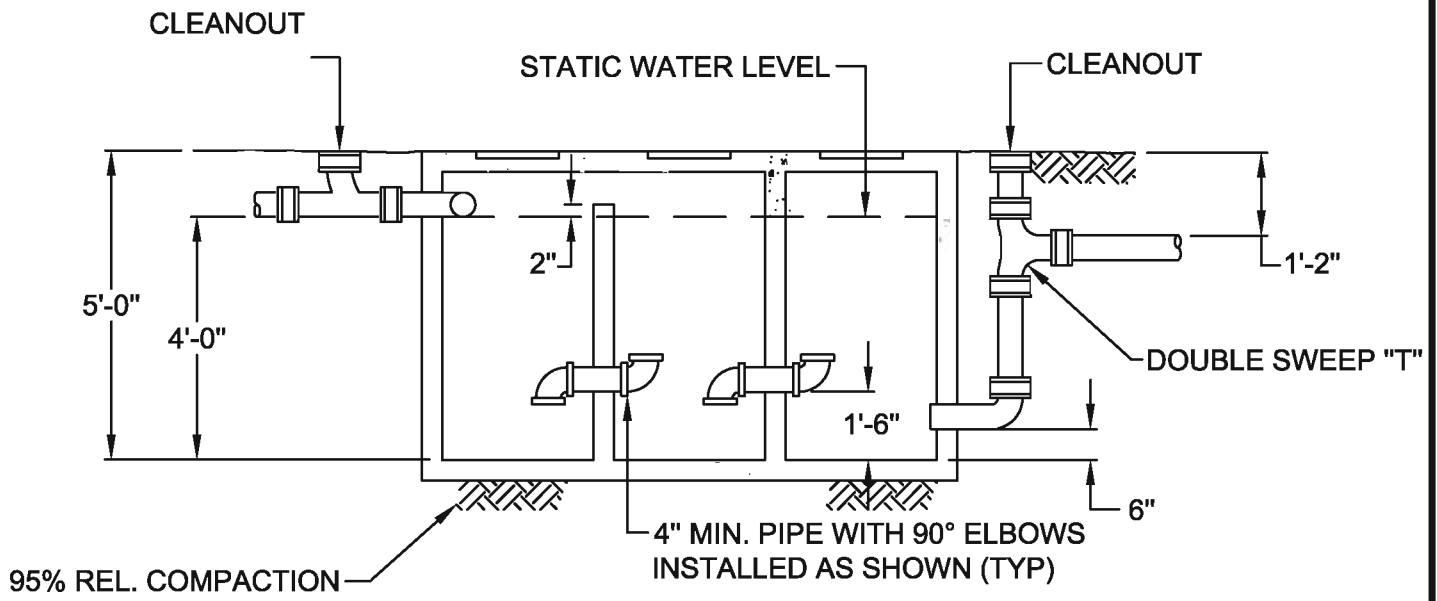

SECTION VIEW

NOTES:

1. DIMENSIONS SHOWN ARE FOR MINIMUM SIZE (750 GALLON) TRAP.
2. EACH UNIT SHALL BE DESIGNED BY A REGISTERED CIVIL ENGINEER AND APPROVED BY THE CITY ENGINEER. STREET INSTALLATIONS SHALL BE DESIGNED FOR H-20 LOADING.
3. CONCRETE SHALL BE A MINIMUM OF 3,000 PSI @ 28 DAYS.
4. ALL WASTE SHALL ENTER TRAP THROUGH INLET PIPE ONLY.
5. COVERS SHALL BE STEEL AND SHALL BE GAS TIGHT.
6. VELOCITY THROUGH TRAP WILL BE LESS THAN 2 FEET PER SECOND AT MAX. FLOW RATE.

NO.	REVISED	BY	Typical Sand and Oil Trap	APPROVED
				 CITY ENGINEER RCE-28191
				DATE: 2-2-99
DRAWN BY: TP			CITY OF RIPON	STANDARD NO. SD-14
CHECKED BY: DJR				
<small>V:\25_City of Ripon Standards\Standard Specifications\Drawings\Storm\SD-14.dwg</small>				